
70,000 PPH 395 PSI RENTAL BOILER

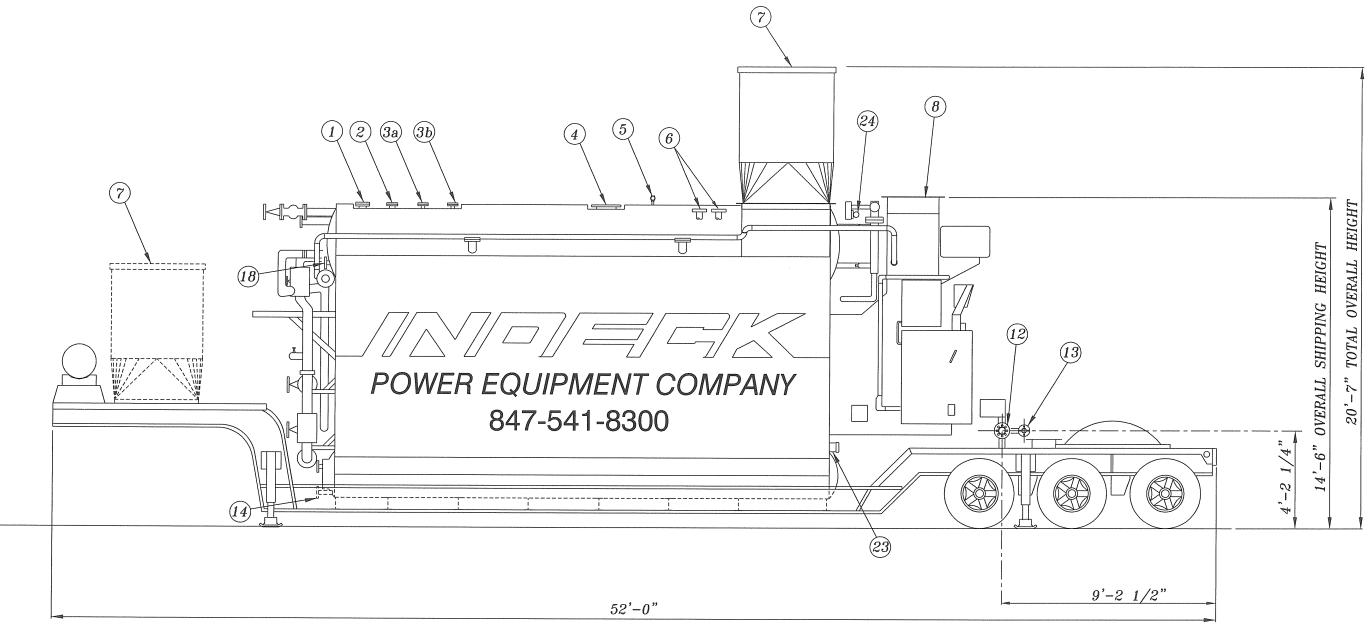

INSTALLATION SERVICE CONNECTIONS

- 4"-600# SAFETY VALVE CONNECTION
 (SAFETY VALVE MUST BE REMOVED FOR TRANSPORT)
 4"-600# SAFETY VALVE CONNECTION
- (SAFETY VALVE MUST BE REMOVED FOR TRANSPORT)
 3a. 2"-600# SAFETY VALVE CONNECTION
- (SAFETY VALVE MUST BE REMOVED FOR TRANSPORT)
 3b. 2"-600# SAFETY VALVE CONNECTION
- (SAFETY VALVE MUST BE REMOVED FOR TRANSPORT)
 4. 8"-300 # MAIN STEAM OUTLET CONNECTION
- 5. 1" NPT DRUM VENT / AUX CONNECTION
 6. 2-1/2"-300 # OPTIONAL ECONOMIZER CONNECTIONS
- 7. FLUE GAS STACK AND TRANSITION (REMOVED FOR TRANSPORT)
- 8. UPPER F.D. FAN HOUSING (REMOVABLE TO PROVIDE ADDITIONAL SHIPPING CLEARANCE (FLANGED))
- 9. 1 1/2"-300# AUX ATOMIZING AIR / STEAM CONNECTION (LOCATED BEHIND CABINET)
- 10. 1/2" NPT PILOT GAS CONNECTIONS (NAT OR PROPANE)

- 11. 3/4" NPT FUEL OIL INLET (LOCATED ON OPPOSITE SIDE OF TRAILER)
- 12. 4"-150 # FUEL GAS CONNECTION
- 13. 2"-150 # GAS VENT OUTLET
- 14. 1-1/2"-300 # BLOW OFF CONNECTION
- 15. 1-1/2"-300 # LOWER DRUM HEATING COIL CONNECTIONS FEEDWATER TEMPERATURE:
- 16 3/4" NPT CHÉMICAL FEED CONNECTION
 17. 1" CONTINUOUS BLOWDOWN CONNECTION
- (LOCATED ON OPPOSITE SIDE OF TRAILER)
 18. 2-1/2"-300 # FEEDWATER SUPPLY CONNECTION
- 19. 460/60/3 POWER SUPPLY 150 AMPS
- 20. 2"-300# SOOT BLOWER STEAM SUPPLY CONNECTION 21. 2"-300# CHEMICAL CLEANING CONNECTION
- 22. 1" NPT FURNANCE PRESS CONNECTION 23. WASHOUT
- 24. 1" NPT INSTRUMENT AIR CONNECTION

DESIGN DATA

OVERALL LENGTH: 52'-0" 10'-6" OVERALL WIDTH: 89,750 LBS NET WEIGHT (INCL TRAILER): 70,000 PPH CONTINUOUS CAPACITY: DESIGN PRESSURE: 395 PSIG 240 DEG F FURNACE VOLUME: 854 CU. FT. CONVECTION HEATING SURFACE: 3460 SQ. FT. RADIANT HEATING SURFACE: 650 SQ. FT.

TOTAL HEATING SURFACE: 4110 SQ. FT. (A.S.M.E.)
GAS SUPPLY PRESSURE 10 PSIG (REGULATED BY CUSTOMER)
OIL SUPPLY PRESSURE 30 PSIG FLOODED MAX.

FEED WATER PRESSURE
INSTRUMENT AIR PRESSURE

30 PSIG FLOODED MAX.
75-100 PSIG ABOVE OPERATING PRESSURE
50 PSIG MIN.

NOTE: A NATURAL GAS OR PROPANE PILOT IS REQUIRED FOR OIL

NOTE 2: PROVIDE ADEQUATE WEATHER
PROTECTION FOR BURNER, CONTROLS
AND PERSONNEL